


**PANOLA-HARRISON ELECTRIC COOPERATIVE INC**  
**BOX 1058 MARSHALL TX 75671**  
**PHONE 903-935-7936 1-800-972-1093**

**STANDARD METER POLE SPECIFICATION**  
**MOBILE HOMES OR TEMPORARY SERVICE**  
**120/240 VOLT, SINGLE PHASE**

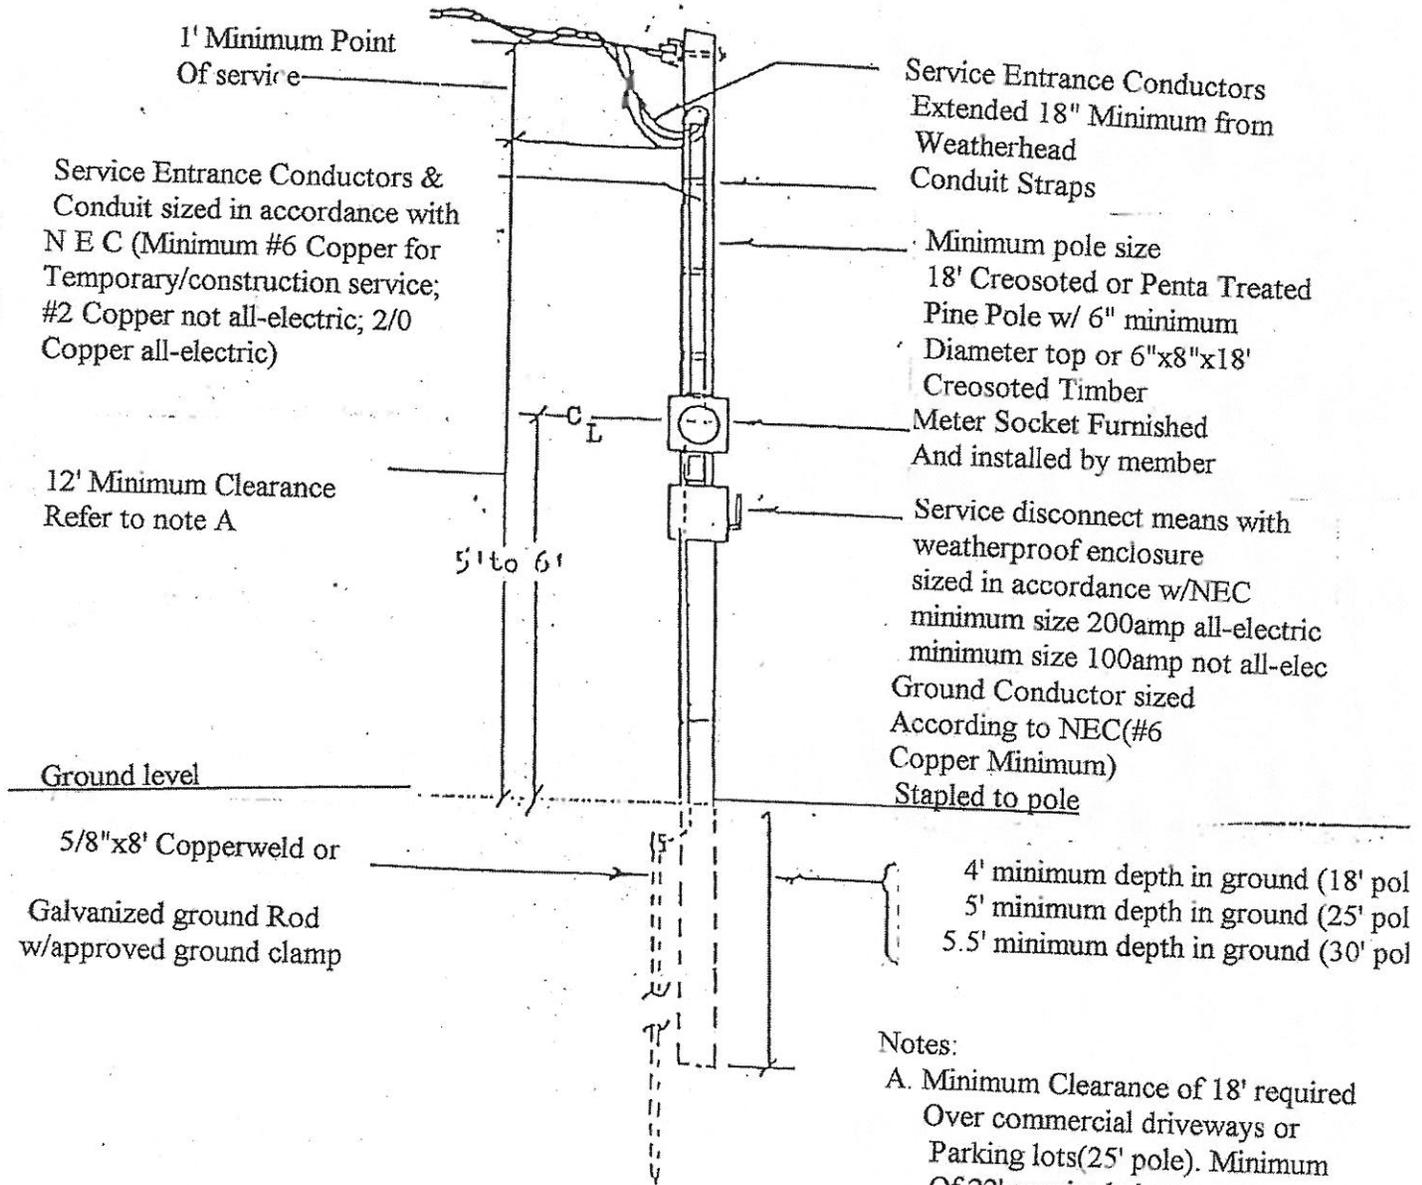

- Notes:
- A. Minimum Clearance of 18' required Over commercial driveways or Parking lots(25' pole). Minimum Of 22' required clearance over public street (30' pole).
  - B. NEC refers to latest edition of National Electrical Code.
  - C. All wiring shall be in accordance W/ National Electrical Code.

Revised: 9-2-06