


PANOLA-HARRISON ELECTRIC COOPERATIVE, INC.

BOX 1058 PHONE 935-7936

MARSHALL, TEXAS 75670

STANDARD METER LOOP SPECIFICATION

Permanent Residence Low Roof House
120/240 Volt, Single Phase

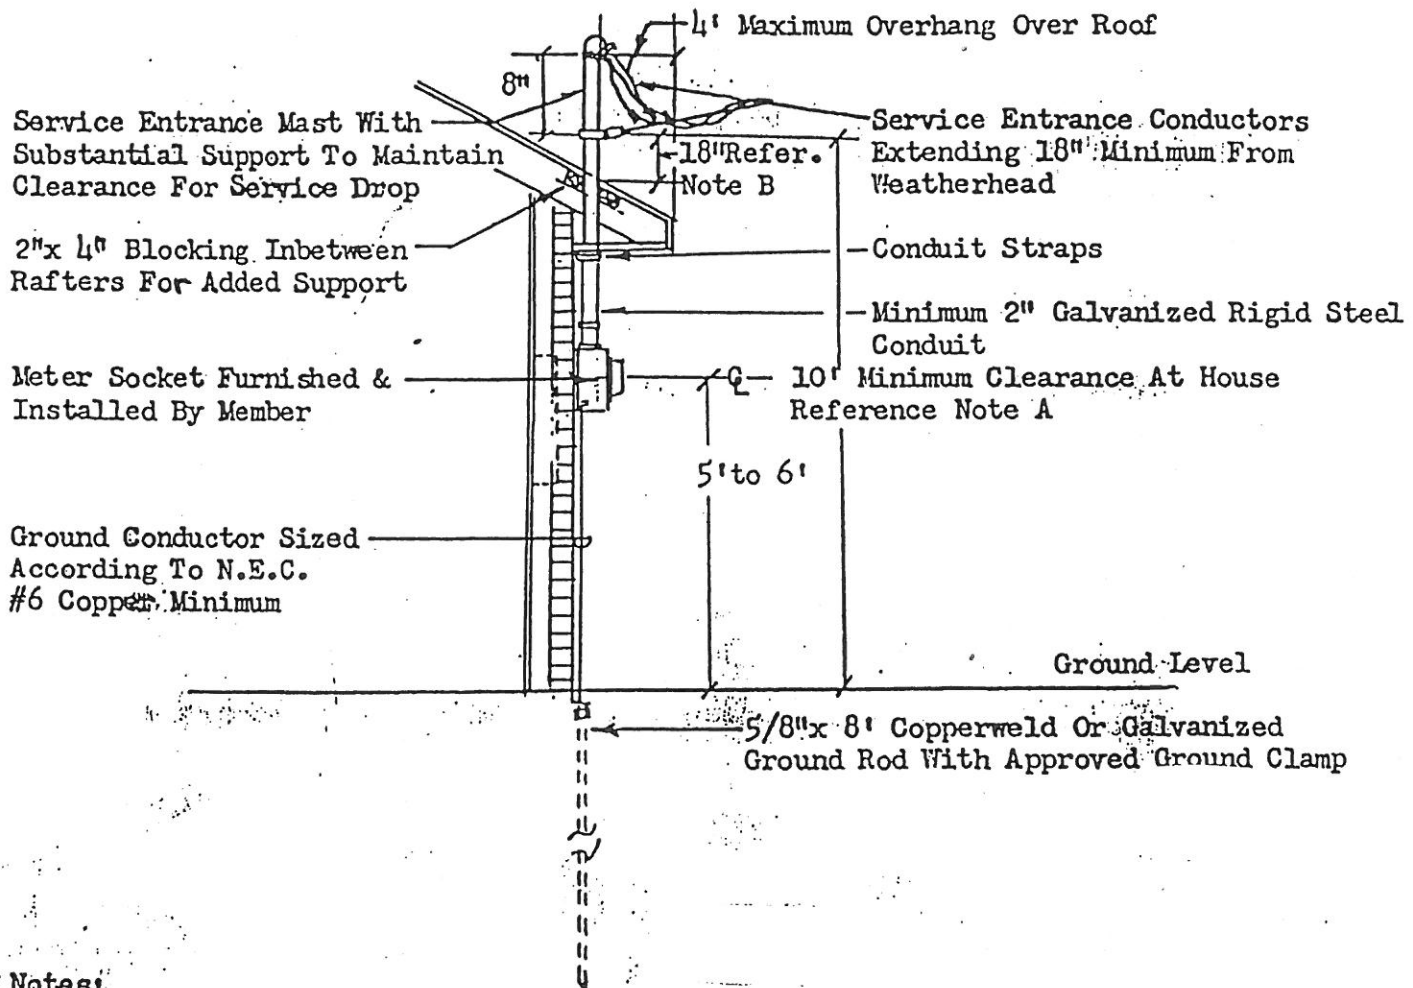

Notes:

- A. Point of Attachment Must Be of Sufficient Height To Maintain A 12' Minimum Clearance Above Residential Drives, 18' Minimum Clearance Over Commercial Drives And Parking Lots, and 22' Minimum Clearance Over Public Streets.
- B. This Dimension Is Increased To 8' If More Than 4' Of Service-Drop Conductor Pass Over The Roof Overhang. If Roof Slope Is 4 to 12 Or Greater, Then This 8' Dimension May Be To 9'.
- C. All Wiring Shall Be In Accordance With National Electrical Code.
- D. N.E.C. Refers To Latest Edition Of National Electrical Code.